

VIRTUAL POWER PLANT (VPP), CONCEPT AND COMPONENTS TO PROMOTE POWER SYSTEM DECENTRALISATION

Kamil Kehinde. R¹. * Sallaudeen Maryam .O. ², and Hameed Faisal³

¹ Research Department, Nigerian Building and Road Research Institute, Abuja, Nigeria.

² Faculty of Electrical Engineering and Information Technology, TU Dortmund, Germany.

³ Department of Electrical and Computer Engineering, New York University, Abu Dhabi, UAE.

*Corresponding author: kehinde.kamil@nbrri.gov.ng

Keywords

Distributed Energy Resources, Energy Market, Virtual Power Plant, Micro grid, Energy Management System

ABSTRACT

With the continuous penetration of distributed energy resources (DER) in the electricity market and power grid, new technologies will continue to influence the way we manage electricity generation and the distribution channels with the goal of easing transmission and distribution of electrical power to consumers. In order to handle distributed generation and to intensify its visibility within power markets, the idea of virtual power plant (VPP) has emerged. Virtual Power plant integrates energy resources with storage and controllable loads to provide capacity and ancillary services to the grid operations. It is composed of combining various small size distributed generating units to form a “single virtual generating unit” that can act as a conventional one and capable of being visible or manageable on an individual basis. Present paper tries to shed light on main issues related to the idea of the VPP. The definitions, primary concepts and types of VPPs will be reviewed in this study to draw a conclusion on why VPPs decentralization of power sector is vital for the continuous integration of micro grid and renewable energies for a sustainable power transaction economy.

INTRODUCTION

Distributed generation is the term used when electricity is generated from sources, often renewable energy sources, near the point of use instead of centralized generation sources from power plants. As the electric utility industry enters an increasingly competitive environment, utilities must concern themselves with the market value of the services they provide and the cost of providing those services. At the same time utilities are still burdened with the obligation to serve their customers with adequate reliability. Utilities must undertake new investments in demand-side resources to meet this obligation [1-3].

The penetration of Distributed Energy Resources (DER) is rising fast worldwide, which is mainly associated with the requirement of a sustainable energy system with less environmental problems, more diversified energy resources and enhanced energy efficiency [4]. The continuing process of liberalization of the electricity market,

i.e. the changeover from the monopoly system to competitive market structures, also attracts more and more attention [5-9]. Recent trends in small-scale distributed generation particularly drastic price reductions of PV and small wind turbines will soon result in high penetration levels of variable generation, some of which are not directly controlled by the utility. Moreover, much of this generation is highly intermittent.

In the context of these two tendencies, running a great number of DER units under market conditions is inevitable, which yet poses new challenges that have to be addressed including Taking part in market i.e. Considered as small, modular power sources, storage technologies and controllable loads [10], DER is generally prohibited from entering the current electricity market [11-12]. The Intermittent nature of many DER technologies like solar cells and wind turbines are weather dependent, their fluctuating output is therefore considered non-dispatchable which not only limits their contribution to grid operation, but also causes economic penalties associated with unexpected unbalances. Furthermore, Many DER units are working isolated due to their different ownerships. Cooperation and communication often lack between neighboring DER units, thus the capability of DER is restricted to satisfy the local needs rather than the whole grid.

One way to address these issues is to aggregate a number of DER units in a so-called Virtual Power Plant (VPP). In this construction, the group of DER units will have the same visibility, controllability and market functionality as the conventional transmission-connected power plants [13-15]. The definitions, primary concept and types of virtual power plant will be reviewed in this study looking at the challenges of VPP in resource allocation, control and operation to draw a conclusion on the viability of the integration to distributed energy resources (DER).

CONCEPTULIZATION OF VIRTUAL POWER PLANT

Virtual power plants (VPPs) are among the promising ways that variable generation and flexible demand may be optimally balanced in the future. In [16] VPP is defined the same as an autonomous micro-grid. In [7], VPP is defined as an aggregation of different type of distributed resources which may be dispersed in different points of medium voltage distribution network. In [17], VPP is composed of a number of various technologies with various operating patterns and availability which they can connect to different point of distribution network. In [14] VPP defines as a multi-technology and multi-site heterogeneous entity. In the FENIX project concept of VPP is defined as: "A Virtual Power Plant (VPP) aggregates the capacity of many diverse DERs, it creates a single operating profile from a composite of the parameters characterizing each DERs and can incorporate the impact of the network on aggregate DERs output. A VPP is a flexible representation of a portfolio of DERs that can be used to make contracts in the wholesale market and to offer services to the system operator [18-20].

VIRTUAL POWER PLANT AND A MICROGRID

A virtual power plant is a cluster of dispersed generator units, controllable loads and storages systems, aggregated in order to operate as a unique power plant. The generators can use both fossil and renewable energy source. Microgrids (and minigrids) also often involve a mix of distributed renewables, storage, flexible demand and fossil-fuel plants. But there are important differences to virtual power plant which includes:

- VPPs are integrated into the grid. Microgrids are often off-grid, and in an on-grid setting, they are designed to be islanded so they can carry on working independently if the grid goes down.
- VPPs can be assembled using assets connected to any part of the grid, whereas microgrids are usually restricted to a particular location, such as an island or a neighborhood.
- The two concepts use different systems for control and operation. VPPs are managed via aggregation software, offering functions meant to mimic those of a traditional power plant control room. Microgrids

rely on additional hardware-based inverters and switches for islanding, on-site power flow and power quality management.

- Another difference concerns markets and regulation. VPPs are aimed at wholesale markets and do not usually require specific regulation. Microgrids, on the other hand, are more focused on end-user power supply [20].

The heart of a VPP is an energy management system (EMS) which coordinates the power flows coming from the generators, controllable loads and storages. The communication is bidirectional, so that the VPP can not only receive information about the current status of each unit, but it can also send the signals to control the objects [16, 21].

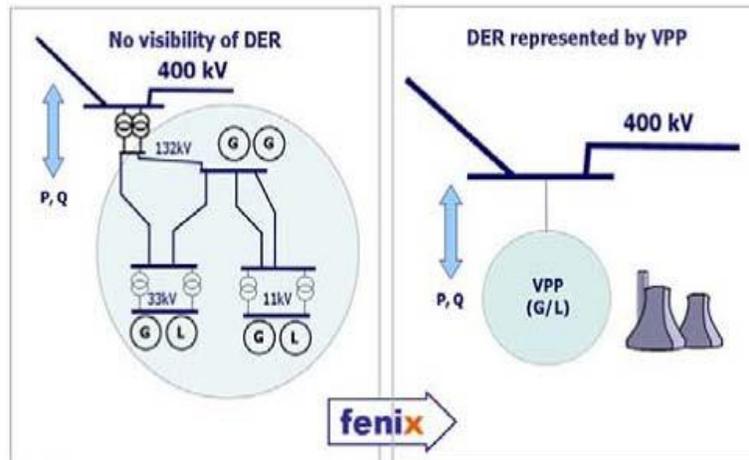


Figure 1. VPP Concept in FENIX [21]

The mentioned Energy Management System (EMS) can operate according to its targets which can be, for example, the minimization of the generation costs, minimization of production of greenhouse gasses (GHG) and maximization of the profits. In order to achieve such targets the EMS needs to receive information about the status of each unit on the one hand, and on the other hand forecast - especially for renewable units like wind and photovoltaic (PV). Furthermore, the information about the possible bottlenecks in the grid plays a relevant role in the optimization process of the VPP operation. In this way the EMS can choose the optimal “modus operandi”. Due to the fluctuating nature of renewable energy sources, the prediction of the energy production is not an easy procedure. Actually, for Wind Park, the day ahead forecasting errors are between 9 and 19 %. Due to such errors, power networks with a high penetration of renewable energy sources, can easily have bottleneck and balancing problems. These problems can be faced either by using ESS or NSM. Although ESS and NSM are the most used instruments, in some cases alternative solutions can be also used. For example, in regions poor of fresh water, desalination plants that are driven by the electricity surplus can be an optimal solution to face bottleneck situations [21].

VIRTUAL POWER PLANT COMPONENTS

VPP introduces smart grids co-ordinate. The needs and capabilities of all generators, grid operators, end-users and electricity market stakeholders to operate all parts of the system as efficiently as possible, minimizing costs and environmental impacts while maximizing system reliability.

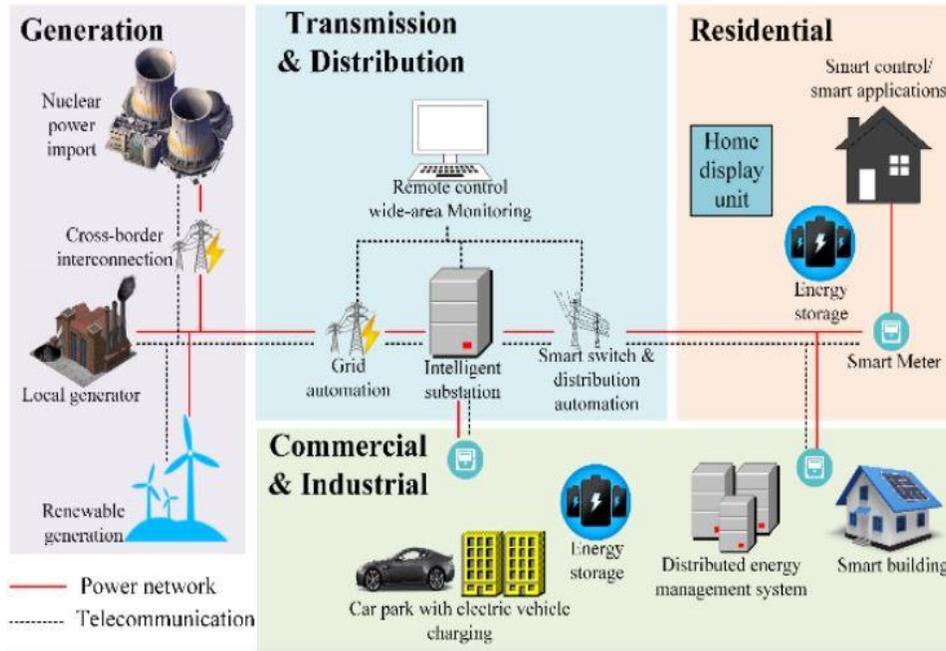


Figure 2: The overall smart grid concept. It is capable of providing electrical power from multiple and widely distributed sources, such as from wind turbines, solar power systems, and plug-in hybrid electric vehicles. It uses digital automation technology for monitoring, control, and analysis through the supply chain [22].

The ideal Virtual Power Plant consists of three main parts including:

A. Generation Technology

The DG specification is useful to broadly mention the range of capabilities for various technologies, generally falling under the distributed generation category. DER considered for integration in VPP:

- CHP (Combined Heat and Power)
- Biomass and biogas
- Small power plants (gas turbines, diesels, etc.)
- Small Hydro-plants
- Wind based energy generation
- Solar production
- Flexible consumption (controllable/dispatchable loads)

In this respect all of DGs can be classified into two categories which are defined in [23].

Domestic Distributed Generator (DDG), it is a small DG unit which serves individual consumer for residential, commercial or industrial parts. The surplus power production of a DDG owner may be injected to the grid as well as its shortage may be compensated by the grid.

Public Distributed Generator (PDG), it is a DG unit which does not belong to an individual consumer and its primary aim is to inject its power production to the grid. Generally, both DDG and PDG can be equipped with energy storage. DDG is referred to a generator with a load and probably an energy storage which is usually connected to low voltage distribution network. On the other hand, PDG is referred to a generator and probably an energy storage which can only be connected to the medium voltage distribution network. The distinctions of DDGs and PDGs are as follow:

1. The aim of the owners of DDGs is to provide economically their electrical and probably heating needs as well as to promote probably their services reliability. They are uninformed of the power business rules. On the other hand, the aim of the owners of PDGs is to sell their power production to the network customers.

2. Generally, the capacities of DDGs generation are small in comparison with PDGs. So, a DDG is never being able to participate in the power market independently as an individual participant, but a PDG may test its chance in the power market.

Some PDGs or DDGs have stochastic nature, e.g. wind and photovoltaic units which are not equipped by energy storages. But some others, e.g. fuel cells and micro turbines, are dispatchable that is; they are capable to vary their regime of operation almost quickly. In this respect, both PDGs and DDGs can be subdivided into two categories, i.e. Dispatchable PDGs (DPDGs) and Stochastic PDGs (SPDGs) for the former and also Dispatchable DDGs (DDDGs) and Stochastic DDGs (SDDGs) for the later [23].

B. Energy Storage Technologies

Energy storage systems can be considered today as a new mean to adapt the variations of the power demand to the given level of power generation. In context of use renewable generation, can be used also as additional sources or as energy buffers in the case of non-dispatchable or stochastic generation, e.g. Wind turbines or PV technologies especially in weak networks. ESS considered for integration in VPP:

- Hydraulic Pumped Energy Storage (HPES)
- Compressed air energy storage (CAES)
- Flywheel energy storage (FWES)
- Super conductor magnetic energy storage (SMES)
- Battery energy storage system (BESS)
- Super capacitor energy storage (SCES)
- Hydrogen along with fuel cell (FC)

C. Information Communication Technology (ICT)

The important requirement for VPP is communication technologies and infrastructure. In many different communications, media technologies can be considered for communications in Energy Management Systems (EMS), Supervisory Control and Data Acquisition (SCADA) and Distribution Dispatching Center (DCC).

TECHNICAL VPP (TVPP) & COMERCIAL VPP (CVPP)

A. Technical VPP (TVPP)

The TVPP consists of DER from the same geographic location. The TVPP includes the real-time influence of the local network on DER aggregated profile as well as representing the cost and operating characteristics of the portfolio. Services and functions from a TVPP include local system management for Distribution System Operator (DSO), as well as providing Transmission System Operator (TSO) system balancing and ancillary services. The operator of a TVPP requires detailed information on the local network; typically this will be the DSO" [17]. The TVPP enables [21]:

- Visibility of DER units to the system operator(s)
- Contribution of DER units to system management
- Optimal use of the capacity of DER units to provide ancillary services incorporating local network constraints

This allows small units to provide ancillary services and reduces unavailability risks by diversifying portfolios and capacity compared to stand-alone DER units. A comprehensive overview of the technological control capabilities of distributed generators and the resulting possibilities of providing ancillary services are analyzed in [18] and [19]. The technological potential is investigated by application of a new assessment approach that considers the grid-coupling converter separately with its particular capabilities. An enormous technological potential is identified. DSOs that use the TVPP concept can also be considered as Active Distribution Network (ADN) operators [20].

An ADN operator can use ancillary services offered by DER units to optimize their network operation. On the other hand, an ADN operator can also provide ancillary services to other system operators. A hierarchical or parallel structure of ADNs may exist where the TVPP concept is applied, for instance according to different voltage levels or different network regions. Many examples of ADNs can be found in the Active Network Deployment Register [24]. Some of the functionalities that have to be performed by TVPP are:

- Continuous condition monitoring - retrieval of equipment historical loadings
- Asset management - supported by statistical data
- Self-identification/self-description of system components
- Fault location - automatically integrated with outage management
- Facilitated maintenance
- Statistical analysis and project portfolio optimization

B. Commercial VPP(CVPP)

A CVPP has an aggregated profile and output which represents the cost and operating characteristics for the DER portfolio. The impact of the distribution network is not considered in the aggregated CVPP profile. Services or functions from a CVPP include trading in the wholesale energy market, balancing of trading portfolios and provision of services (through submission of bids and offers) to the [transmission] system operator. The operator of a CVPP can be any third party aggregator or a Balancing Responsible Party (BRP) with market access; e.g. an energy supplier" [24]. The CVPP enables [25]:

- Visibility of DER units in energy markets
- Participation of DER units in the energy markets
- Maximization of value from participation of DER units in the energy markets

This allows market access of small units and reduces the risk of imbalance by portfolio diversity and capacity compared to stand-alone DER units. CVPPs perform commercial aggregation and do not take into consideration any network operation aspects that active distribution networks have to consider for stable operation [26-28]. The aggregated DER units are not necessarily constrained by location but can be distributed throughout different distribution and transmission grids. Hence, a single distribution network region may have more than one CVPP aggregating DER units in its region.

Basic CVPP functionalities would be optimization and scheduling of production based on predicted consumers' demand and generation potential. When actual needs differ from predicted ones, DRRs (Demand Response Resources) are introduced to fill the gap between production and real consumption. In general, CVPP functions should also include [29]:

Maintenance and submission of DERs' characteristics

- Production and consumption forecast
- ODM (Outage Demand management)
- Building DER bids
- Bids submissions to the market
- Daily optimization and generation scheduling
- Selling energy provider by DERs to the Market

CONCLUSION

With the continuous growth of energy industry, the population of DERs dispersed globally will continue to increase proportionally. Transforming power system by decentralizing the supply link to make room for flexible power market trading. The concept of VPP allows individual DERs to gain access and visibility across all energy markets, and benefit

from VPP market intelligence to optimize their position and maximize revenue opportunities. System operation can benefit from optimal use of all available capacity and increased efficiency of operation. Benefits from the Virtual Power Plant concept have been identified for different stakeholders ranging from improved co-ordination between the DSO and TSO, increased visibility of DER units for consideration in network operation and mitigating the complex operation caused by the growth of inflexible distributed generation. The benefit of DERs when looked at for policy makers ranges from facilitate the targets for renewable energy deployment and reduction of CO₂ emissions, cost effective large-scale integration of renewable energies while maintaining system security and increasing the global efficiency of the electrical power system by capturing flexibility of DER units. Increasing the global efficiency of the electrical power system by capturing flexibility of DER units. VPP can utilize user and generation side resources to realize interaction between power grid and users thereby reducing the investment costs and integrating coordinated control technology in power utilization.

References

- 1) F.F. Wu, K. Moslehi, and A. Bose, "Power System Control Centers: Past, Present, and Future", *Proceeding of IEE*, vol.93, , pp.1890-1907, Nov 2005.
- 2) I. Kamphuis, J. Kok, C. Wamer, and M. Hommelberg, "Massive Coordination of Residential Embedded Electricity Generation and Demand Response Using the PowerMatcher Approach", *The 4th International Conference on Energy Efficiency in Domestic Appliances and Lighting- EEDAL06*, 2007.
- 3) R. Skovmark, and J. H. Jacobsen, "Analysis, Design and Development of a Generic Framework for Power Tradin, M.Sc thesis, available from Technical University of Denmark, 2007.
- 4) H. Morais, P. Kadar, M. Cardoso, Z. Vale, and H. Khodr, "VPP operating in the isolated grid", *IEEE Power and Energy Society General Meeting - Conversion and Delivery of Electrical Energy in the 21st Century*, Pittsburgh (PA), pp.1-6. Jul 2008.
- 5) Pudjianto, C. Ramsay, G. Strbac: "The FENIX vision: The Virtual Power Plant and system integration of distributed energy resources", *FENIX Deliverable 1.4.0*, 21 Dec 2006.
- 6) E. Mashhour, and S.M. Moghaddas-Tafreshi, "The Opportunities for Future Virtual Power Plant in the Power Market, a View Point", *2009 International Conference on Clean Electrical Power*, pp. 448 – 452, 2009.
- 7) ENIRDGnet: Concepts and opportunities of Distributed Generation: The Driving European Forces and Trend., *ENIRDGnet Project deliverable D3*, 2003
- 8) J.O. Wara: Current status and Evaluation of Electricity market liberalization in Japan, USA and Europe. *IEE 391st regular research session*, May 2005.
- 9) N.R. Friedman, "Distributed Energy Resources Interconnection Systems: Technology Review and Research Needs", *National Renewable Energy Laboratory Report No. NREL/SR-560-32459*, Sept 2002.
- 10) S. Ropenus, and K. Skytte, "Regulatory Review and Barriers for the Electricity Supply System for Distributed Generation in the EU-15", *International Journal of Distributed Energy Resources*, vol. 3, pp. 243-257, 2007.
- 11) R. Caldon, A. Rossi, and R Turri, "Optimal Control of a Distribution System with a Virtual Power Plant", *Bulk Power System Dynamics and Control-VI*, Italy, Aug 2004.
- 12) F. Bignucolo, R. Caldon, and V. Prandoni, "The Voltage Control on MV Distribution Networks with Aggregated DG Units (VPP)", *Proceedings of the 41st International*, vol 1, pp. 187-192, Sep 2006.

- 13) F.F. Wu, K. Moslehi, and A. Bose, "Power System Control Centers: Past, Present, and Future", *Proceeding of IEE*, vol.93, , pp.1890-1907, Nov 2005.
- 14) I. Kamphuis, J. Kok, C. Wamer, and M. Hommelberg, "Massive Coordination of Residential Embedded Electricity Generation and Demand Response Using the PowerMatcher Approach", *The 4th International Conference on Energy Efficiency in Domestic Appliances and Lighting- EEDAL06*, 2007.
- 15) R. Skovmark, and J. H. Jacobsen, " Analysis, Design and Development of a Generic Framework for Power Tradin, M.Sc thesis, available from Technical University of Denmark, 2007.
- 16) H. Morais, P. Kadar, M. Cardoso, Z. Vale, and H. Khodr, "VPP operating in the isolated grid", *IEEE Power and Energy Society General Meeting - Conversion and Delivery of Electrical Energy in the 21st Century*, Pittsburgh (PA), pp.1-6. Jul 2008.
- 17) D. Pudjianto, C. Ramsay, G. Strbac: "The FENIX vision: The Virtual Power Plant and system integration of distributed energy resources", *FENIX Deliverable 1.4.0*, 21 Dec 2006.
- 18) H. Xin, D. Gan, N. Li, H. Li, C. Dai. "Virtual power plant-based distributed control strategy for multiple distributed generators," *IET Control Theory & Applications*, vol. 7, pp. 90-98, Mar. 2013.
- 19) A. Bagchi, L. Goel, P. Wang. "Adequacy Assessment of Generating Systems Incorporating Storage Integrated Virtual Power Plants," *IEEE Trans. Smart Grid*, in press.
- 20) N. Lu, Y. Zhang. "Design considerations of a centralized load controller using thermostatically controlled appliances for continuous regulation reserves," *IEEE Trans. Smart Grid*, vol. 4, pp. 914-921, Jun. 2013.
- 21) D. Wang, H. Jia, C. Wang, N. Lu, M. Fan, W. Miao, et al. "Performance evaluation of controlling thermostatically controlled appliances as virtual generators using comfort-constrained state-queueing models," *IET Generation, Transmission & Distribution*, vol.8, pp. 591-599, Apr. 2014.
- 22) K. El Bakari, W. L. Kling. "Development and operation of virtual power plant system," unpublished, presented at the 2nd IEEE PES International Conference and Exhibition on Innovative Smart Grid Technologies, Manchester, UK, 2011.
- 23) M. Vasirani, R. Kota, R. L. G. Cavalcante, S. Ossowski, N. R. Jennings "An Agent-Based Approach to Virtual Power Plants of Wind Power Generators and Electric Vehicles," *IEEE Trans. Smart Grid*, vol. 4, pp.1314-1322, Sep. 2013.
- 24) Z. Vale, T. Pinto, H. Morais, I. Praca, P. Faria. "VPP's multi-level negotiation in smart grids and competitive electricity markets," unpublished, presented at the 2011 IEEE PES General Meeting, Detroit, MI, USA, 2011.
- 25) M. Giuntoli, D. Poli. "Optimized thermal and electrical scheduling of a large scale virtual power plant in the presence of energy storages," *IEEE Trans. Smart Grid*, vol. 4, pp. 942-955, Jun. 2013.
- 26) M. Zdrilić, H. Pandžić, I. Kuzle. "The mixed-integer linear optimization model of virtual power plant operation," in *Proc. 2011 8th International Conference on the European Energy Market*, pp.467-471.
- 27) S. Ruthe, C. Rehtanz, S. Lehnhoff. "Towards frequency control with large scale Virtual Power Plants," unpublished, presented at the 3rd IEEE PES Innovative Smart Grid Technologies Europe, Berlin, Germany, 2012.
- 28) D. Zubov. "An IoT concept of the small virtual Power Plant Based on Arduino Platform and MQTT Protocol," in *Proc. 2016 International Conference on Applied Internet and Information Technologies*, pp. 95-103.
- 29) H. Pandzic, I. Kuzle, T. Capuder. "Virtual power plant mid-term dispatch optimization," *Applied Energy*, vol. 101, pp. 134-141, Jan. 2013.